


JOINT DETAIL AND SEALANT BY OTHERS

CONCRETE PRECAST PANELS

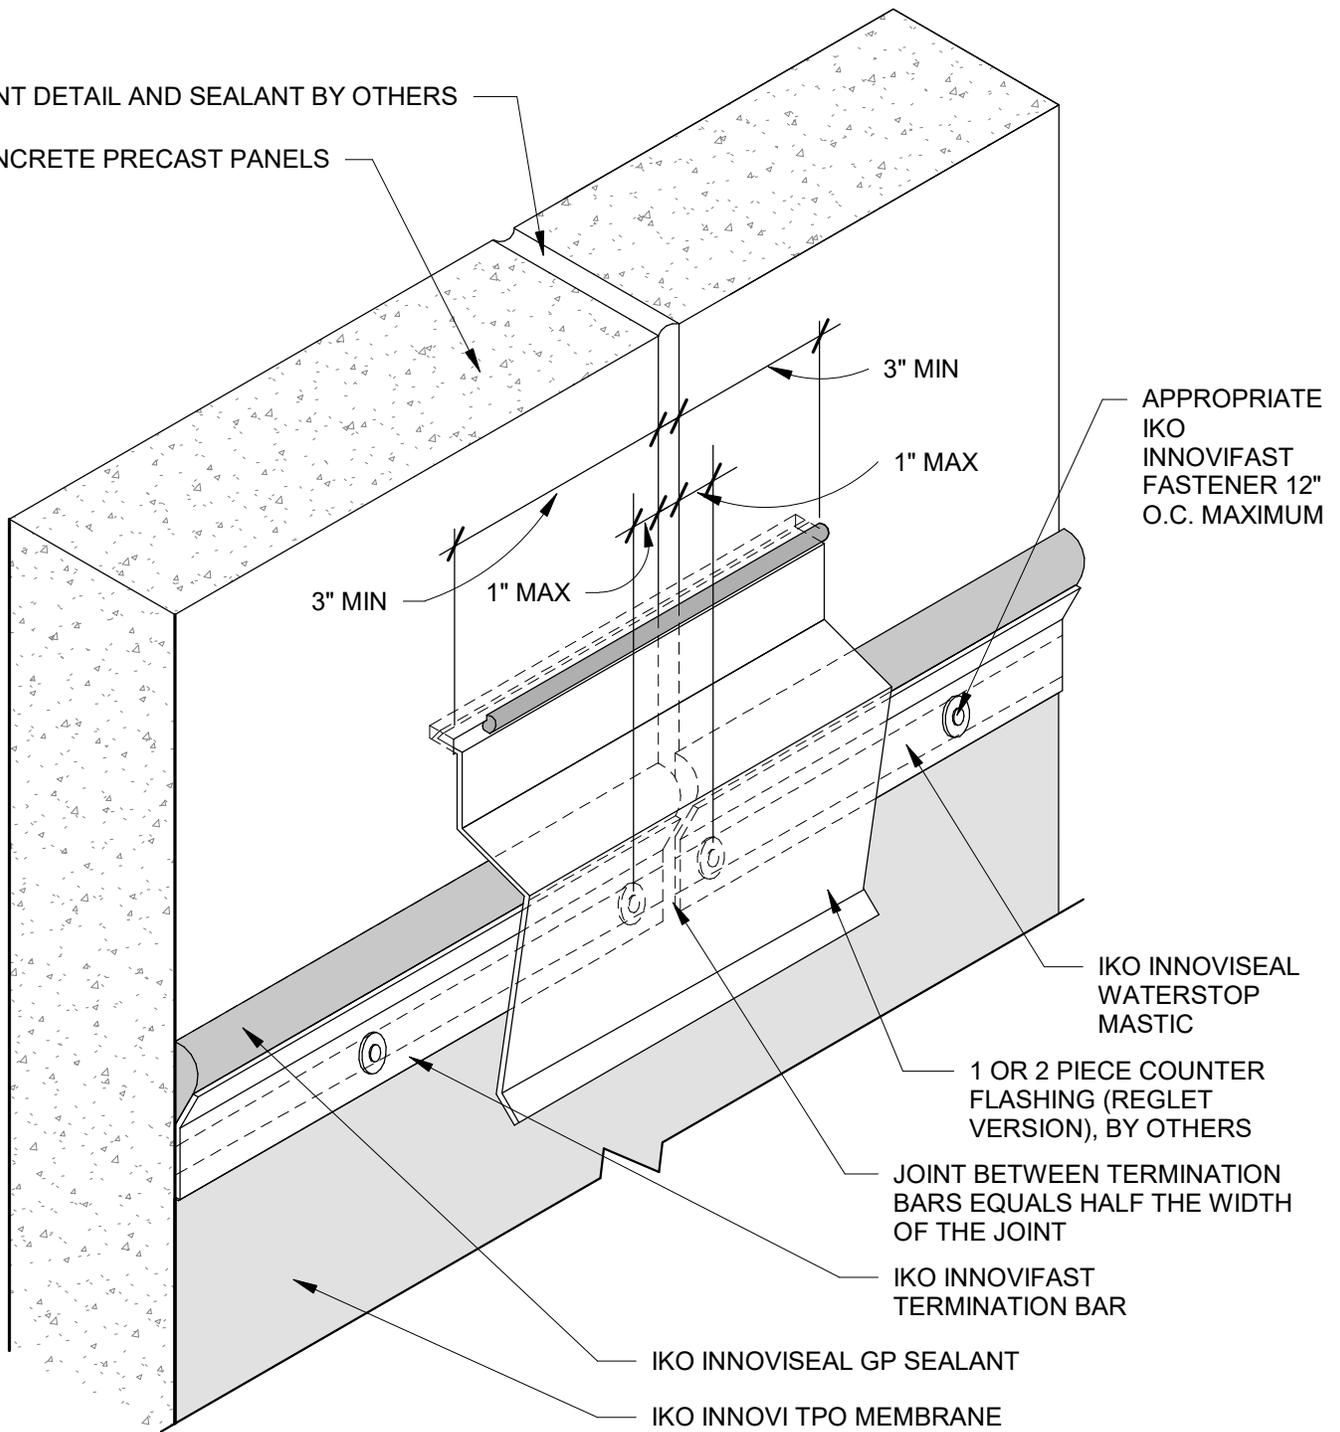

APPROPRIATE
IKO
INNOVIFAST
FASTENER 12"
O.C. MAXIMUM

IKO INNOVISEAL
WATERSTOP
MASTIC

1 OR 2 PIECE COUNTER
FLASHING (REGLET
VERSION), BY OTHERS

JOINT BETWEEN TERMINATION
BARS EQUALS HALF THE WIDTH OF THE JOINT

IKO INNOVIFAST
TERMINATION BAR

IKO INNOVISEAL GP SEALANT

IKO INNOVI TPO MEMBRANE
BELOW TERMINATION BAR

- NOTES:
1. REFER TO IKO.COM/COMM FOR THE MOST UP TO DATE INSTALLATION INFORMATION.
 2. ANY CARPENTRY OR METAL WORK SHOULD BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH LOCAL CODE REQUIREMENTS AND/OR PROJECT SPECIFICATIONS. THESE COMPONENTS SHOULD BE REVIEWED AND APPROVED BY A LICENSED DESIGN PROFESSIONAL. IKO ASSUMES NO RESPONSIBILITY FOR THE INSTALLATION OF THE ASSOCIATED COMPONENTS OR DAMAGE TO THE ROOF SYSTEM DUE TO FAULTY INSTALLATION.
 3. TERMINATION BAR MUST BE CUT AT EACH WALL JOINT AND SECURED TO THE SUBSTRATE WITH THE APPROPRIATE IKO INNOVIFAST FASTENER.
 4. METAL COUNTER FLASHING SHALL BE 24 GAUGE PRE-FINISHED STEEL OR .032 (0.81 MM) MINIMUM ALUMINUM.
 5. ALL SEALANTS/CAULKING SHALL BE PERIODICALLY INSPECTED AND MAINTAINED BY THE BUILDING OWNER THROUGHOUT THE LIFE OF THE ROOF.
 6. MINIMUM FLASHING HEIGHT IS 8" (203 MM) ABOVE THE ROOF SURFACE.

Title: TERMINATION BAR AT TILT UP PANEL JOINT WITH
REGLET COUNTER FLASHING

Detail Number: T-T-9

Issue Date: 8/01/2025

Maximum Warranty Term: 20-Years

Not to Scale



COMMERCIAL

Specify with Confidence.

